

Zapojenie DC špirály podľa počtu FV panelov a výkonu FV panelov
max. 2,3kWp

D) 7ks x 300Wp -330Wp (max.2,3kWp)

6ks x 350Wp – 380Wp (max.2,3kWp)

Bez prepojenie kontaktov špirály



E) 5ks x 400Wp – 460Wp (max.2,3kWp)

5ks x 350Wp – 380Wp (max.2,3kWp)


4ks x 470Wp – 575Wp (max.2,3kWp)

Prepojenie kontaktov 2,3kW a 1,7kW



F) 3ks x 580Wp – 765Wp (max.2,3kWp)

Prepojenie kontaktov 1,15kW a 2,3kW

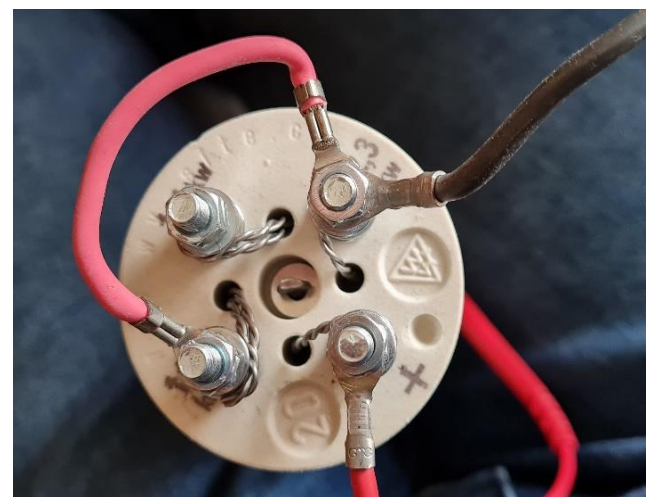


Zapojenie DC špirály podľa počtu FV panelov a výkonu FV panelov

Max. 1,7kWp

G) 5ks x 285Wp – 340Wp (max. 1,7kWp)

4ks x 350Wp – 425Wp (max. 1,7kWp)

Bez prepojenia kontaktov špirály

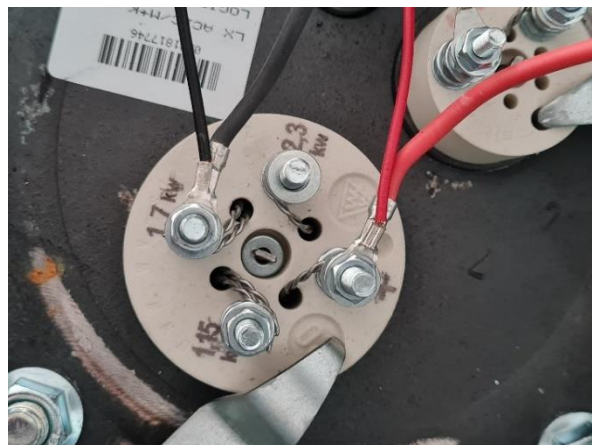

H) 3ks x 430Wp–565Wp (max. 1,7kWp)

Prepojenie kontaktov (+) a **1,15kW**




Zapojenie TPK 150 (2x1,15kW)

Max 2,3kWp

5ks x 400Wp – 460Wp (max.2,3kWp)

5ks x 350Wp – 380Wp (max.2,3kWp)

4ks x 470Wp – 575Wp (max.2,3kWp)

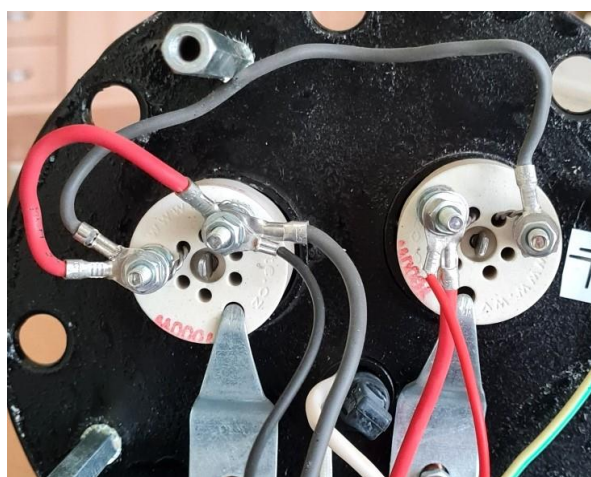

1 x kábel 2,5mm s očkami, dĺžka cca 9,5cm, 2 x matica 5mm, 4 x podložka 5mm

